


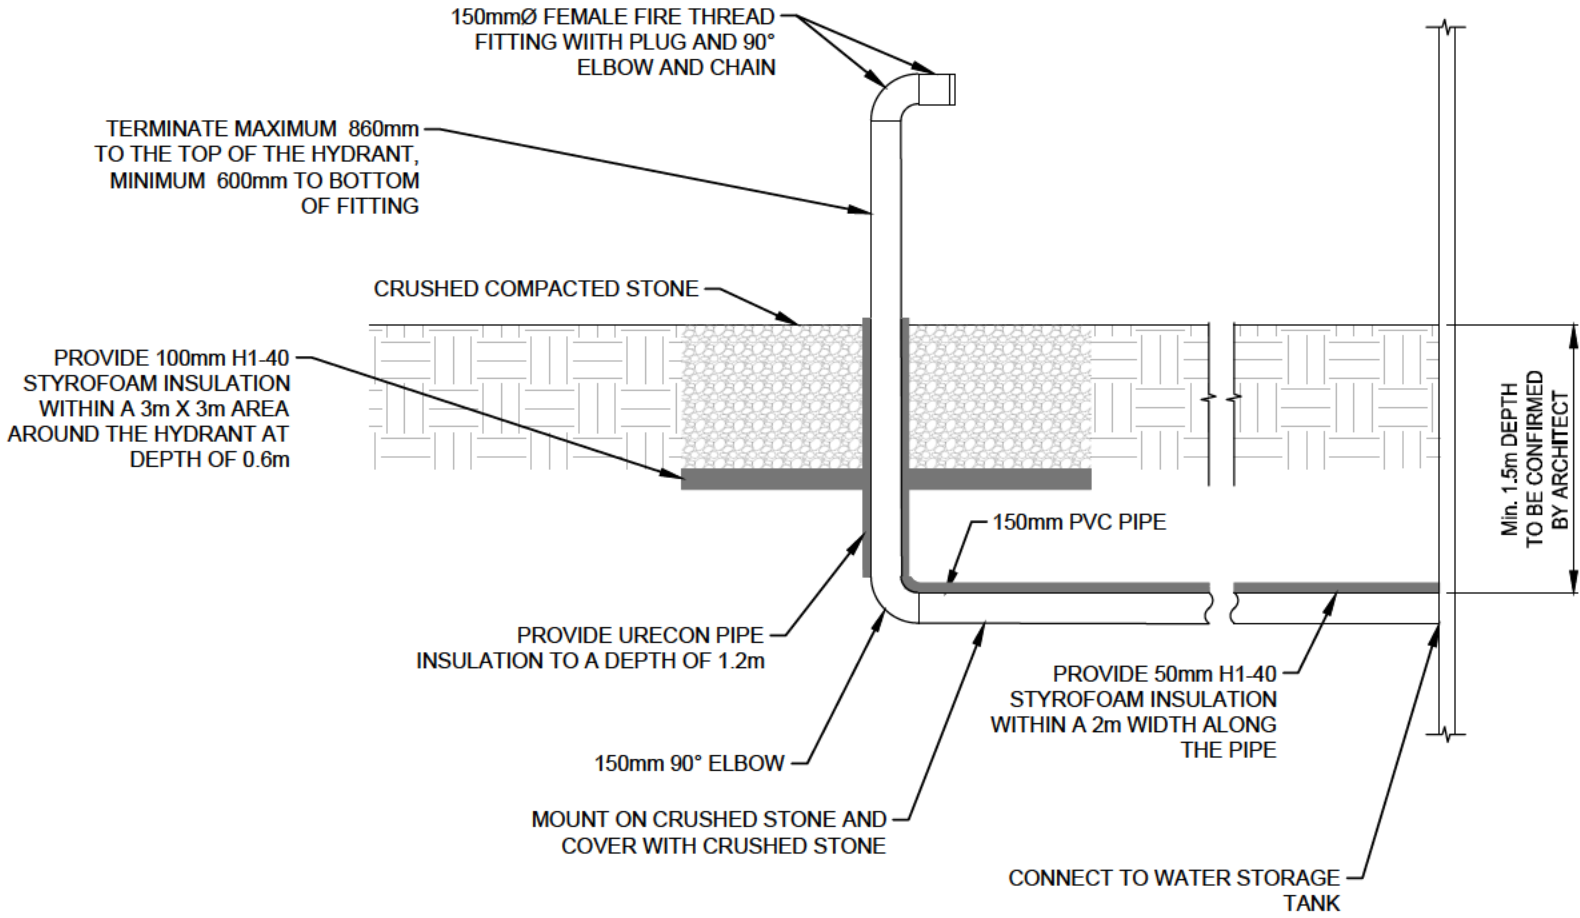


- NOTES:
1. MINIMUM 150mm PIPE, SCHEDULE 40 TO BE USED THROUGHOUT, NON-METAL ABOVE GRADE
 2. TERMINATE MAXIMUM 860mm TO THE TOP OF THE HYDRANT, MINIMUM 600mm TO BOTTOM OF FITTING (SEE NOTE 3 BELOW)
 3. TERMINATE WITH A 150mm FEMALE FIRE THREAD FITTING WITH PLUG
 4. TERMINATE DRY HYDRANT PERPENDICULAR TO THE ACCESS ROAD

1

DRY HYDRANT DETAIL

SCALE: N.T.S.



SURVEY
TOPOGRAPHIC SURVEY PROVIDED
BY ARL SANDY WINKELING
DATED MAY 26, 2024

BENCHMARK
OUT CROSS ON TOP OF CONCRETE CURB, NORTH EASTERLY CORNER
OF CURB ON EAST SIDE OF STORM WATER MANAGEMENT FACILITY

ELEV: 222.28m

NOTES:

2.	ISSUED FOR SPA	BR	2025-01-03
1.	NOT ISSUED IN THIS REVISION	DJ	2024-07-04
No.	REVISION	BY	DATE



2809 TELEVISION ROAD

PTF HOLDINGS

DETAILS

TOWNSHIP OF DOUR-DUMMER	
DRAWN BY: B. RAI	STAMP:
DESIGNED BY: B. RAI	
APPROVED BY: L. PARSONS	
DATE: 2024-12-12	

SCALE: NTS		
PROJECT NUMBER: 21085	SHEET NAME: DT	SHEET: 2 of 2